NOTES:

NO VOLTAGE ABOVE 24V SHOULD BE PUT INTO THE NC TERMINALS

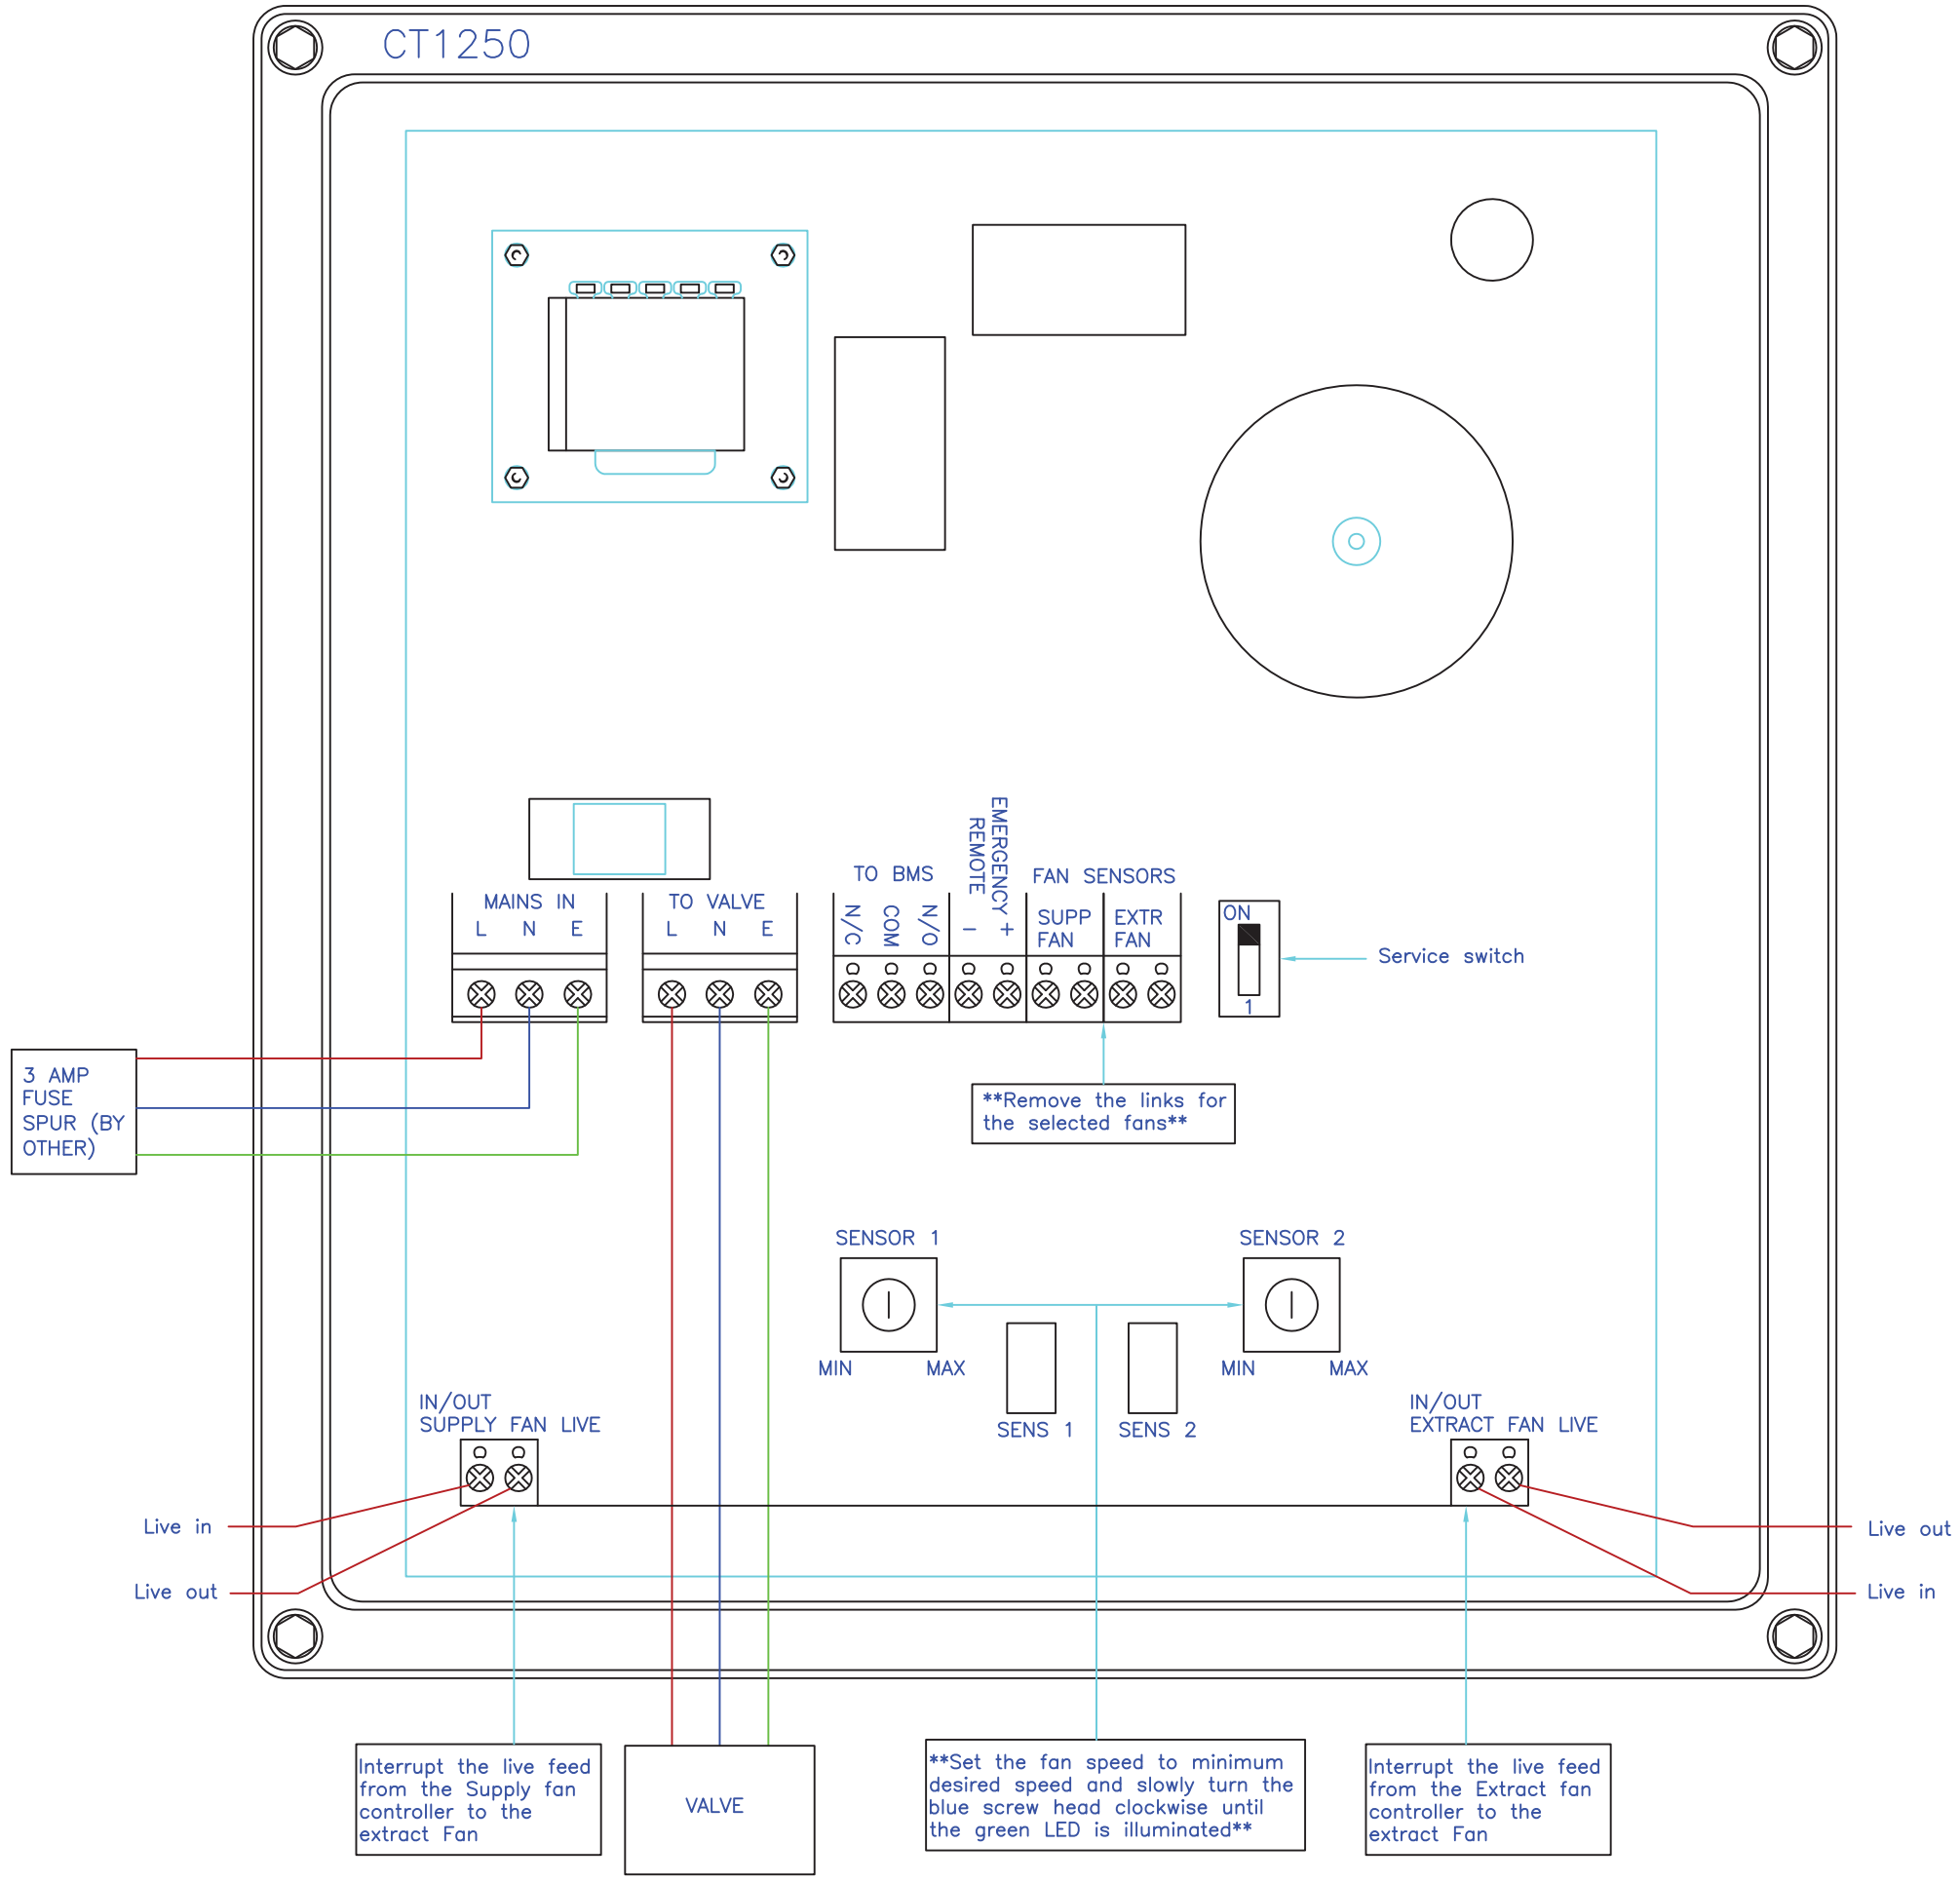

earth

neutral

240v mains live

low voltage

Rev.	Drawn	Chkd.	Apprvd.	Date	Description
-	?	?	?	?	PRELIMINARY

Project

SNS NORTHERN

Drawing Title

CT1250 DIAGRAM

S&S NORTHERN

www.snsnorthern.com

Unit 2, Dickinsons Industrial Estate, Moss Lane, Coppull, Chorley, PR7 5AL

Tel : 01257 470 983, Fax : 01257 471 937 Email: info@snsnorthern.com

Scale (at A1)	Date	Drawn
NOT TO SCALE	11/11	SJB

Drg. no.	Rev.
JOB-DWG-NO	-